


# ENVIRO-TEC® SUBMITTAL DATA

## DIMENSIONAL DATA

UNIT SIZE	D
6	5 $\frac{7}{8}$ "
8	7 $\frac{7}{8}$ "
10	9 $\frac{7}{8}$ "
12	11 $\frac{7}{8}$ "
14	13 $\frac{7}{8}$ "
16	15 $\frac{7}{8}$ "

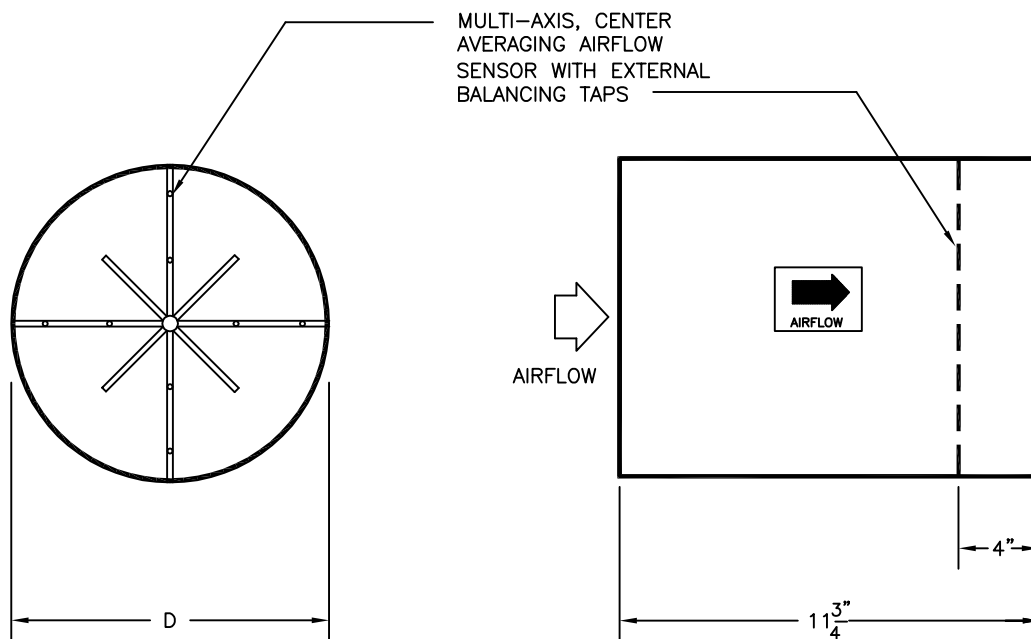

### CONSTRUCTION NOTES:

1. MATERIAL: Galvanized steel; Casing—22 gauge.
2. INSTALLATION: A) Unit should be externally insulated by others (in the field) if required.  
B) For optimum control accuracy, a straight section of duct at least 2 duct diameters long should be installed upstream of the sensor.

NOTE: All drawings subject to change without prior notice.

TITLE:

MODEL RFT-MS  
ROUND MEASURING STATION

 **ENVIRO-TEC®**  
BY JOHNSON CONTROLS

DRN BY: DG	DATE: 12/17/92	SCALE: 1=22
CKD BY: DIG	DATE: 5/28/96	REV: 01

DRAWING NO.

15937